


Meter Vaults shall not be installed in a paved area without the expressed approval of the Water Distribution Engineering Office.

Slope finished grade
1" per foot for 8' from
center of hatch and
manhole openings
(Typical)

-42"x46" Conc. Slab with
H-20 rated U.S.F. Aluminum
Hatch, #THS 30"x30" or Equal.

- Hatch Lid to be drilled
(1/2") for air monitoring.

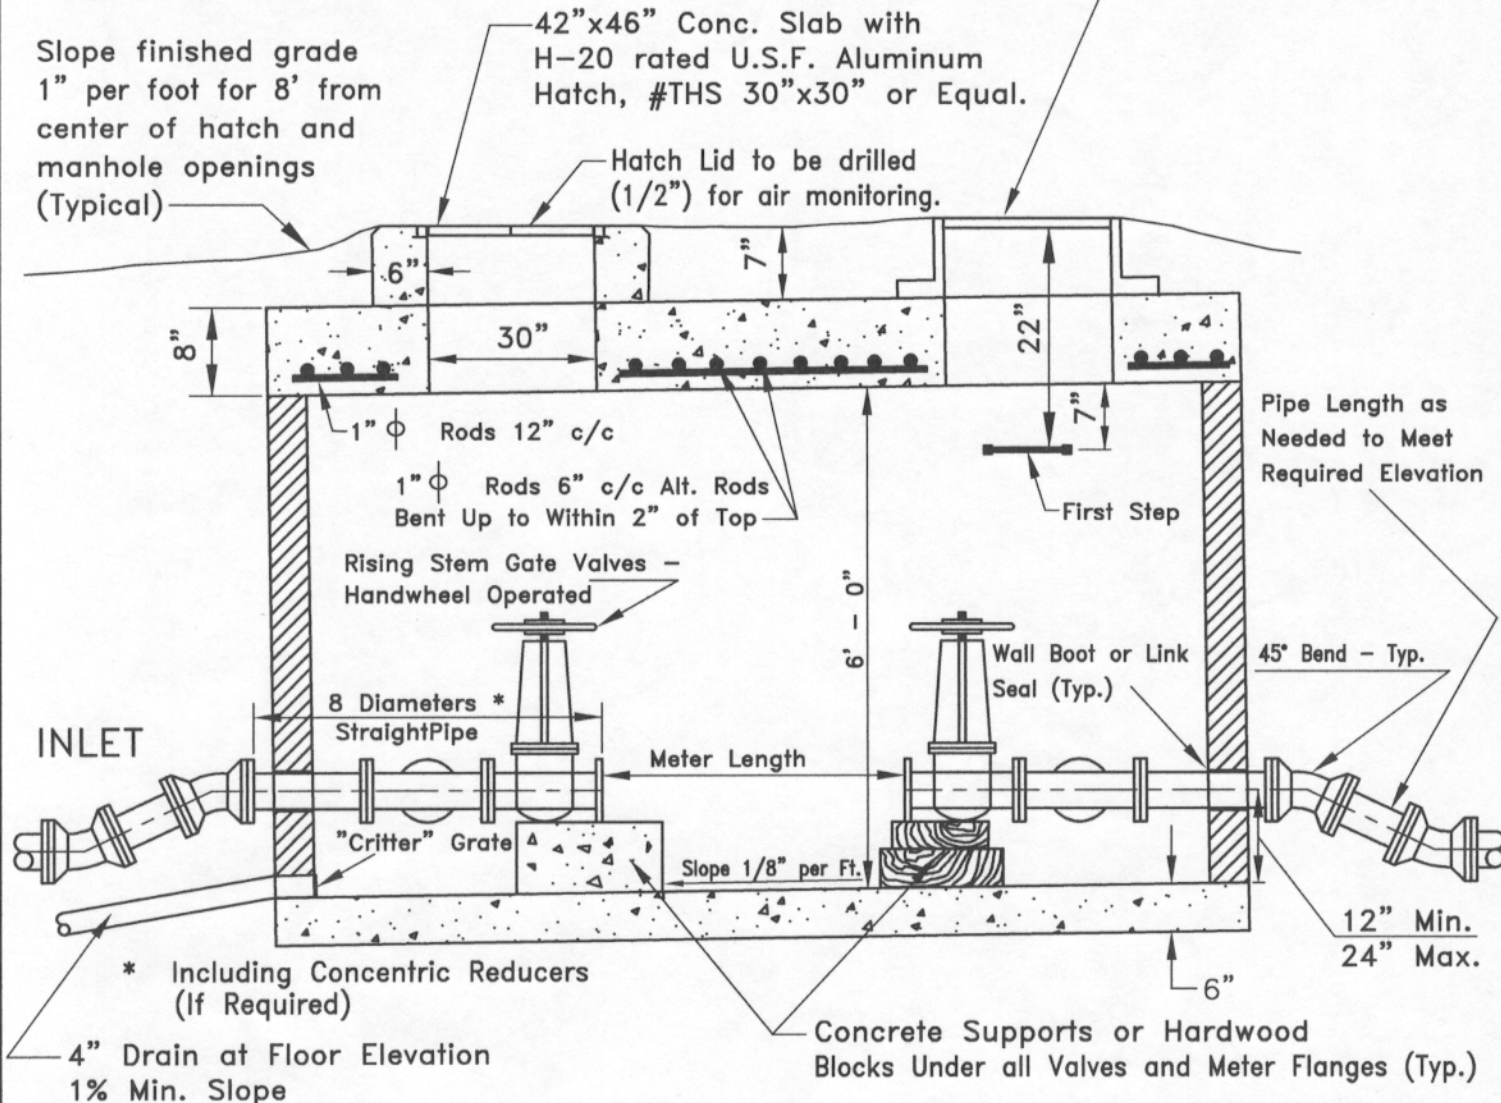

The Vault Floor shall be a min. of 18" above the flow line of the Drainage Ditch or Storm Sewer.

CITY OF COLUMBUS
DEPARTMENT OF PUBLIC UTILITIES
DIVISION OF WATER

APPROVED:

ENGINEER

4/1/61
DATE

STANDARD DETAIL

METER SETTING

1 1/2" thru 10" x 12" METERS

